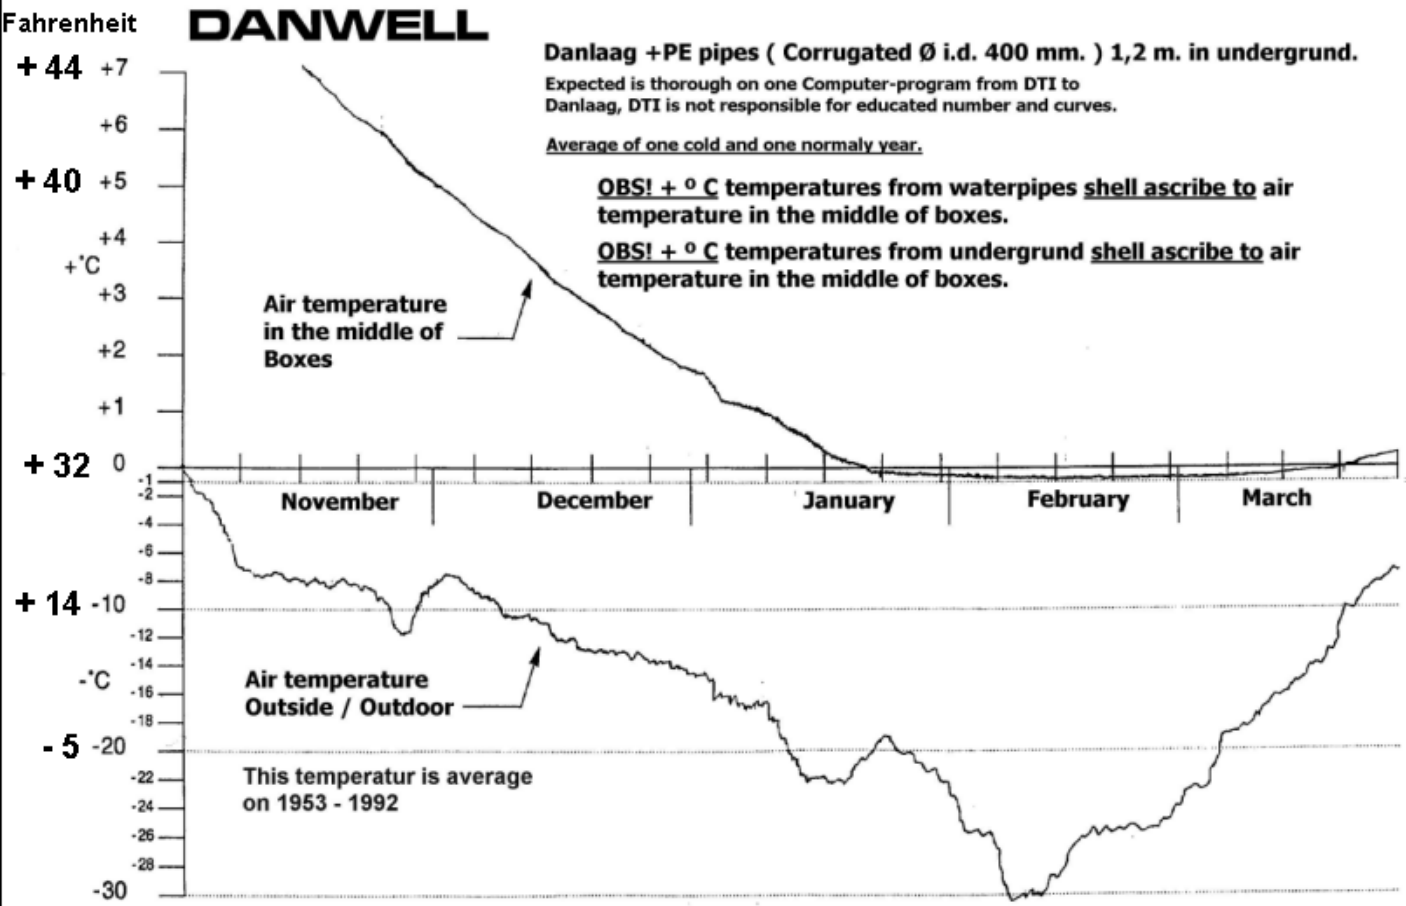

Fahrenheit
DANWELL
Danlaag +PE pipes (Corrugated Ø i.d. 400 mm.) 1,2 m. in undergrund.
Expected is thorough on one Computer-program from DTI to
Danlaag, DTI is not responsible for educated number and curves.
Average of one cold and one normaly year.
OBS! + º C temperatures from waterpipes shell ascribe to air temperature in the middle of boxes.
OBS! + º C temperatures from undergrund shell ascribe to air temperature in the middle of boxes.
+ 44
+ 40
+ 32
+ 14
- 5
+°C
-°C
+7
+6
+5
+4
+3
+2
+1
0
-1
-2
-4
-6
-8
-10
-12
-14
-16
-18
-20
-22
-24
-26
-28
-30
Air temperature in the middle of Boxes
November
December
January
February
March
Air temperature Outside / Outdoor
This temperatur is average on 1953 - 1992